


K605D

Sightproof Louver | Drainable Blade | Extruded Aluminum

Standard Construction

Frame	Heavy gauge extruded 6063-T5 aluminum, 5 in. (127 mm) x 0.081 in. (2 mm) nominal wall thickness
Blades	Chevron design, heavy gauge extruded 6063-T5 aluminum, 0.081 in. (2 mm) nominal wall thickness, positioned on approximately 2 in. (51 mm) centers
Louver Depth	5 in. (127 mm)
Construction	Mechanically fastened
Finish	Mill
Minimum Size	12 in. W x 12 in. H (3048 mm W x 305 mm H)
Maximum Single Section Size	120 in. W x 120 in. H (3048 mm W x 3048 mm H) Limited to 70 sq. ft. (6.5 sq. m)
Wind Load	25 PSF (1.2 kPa)

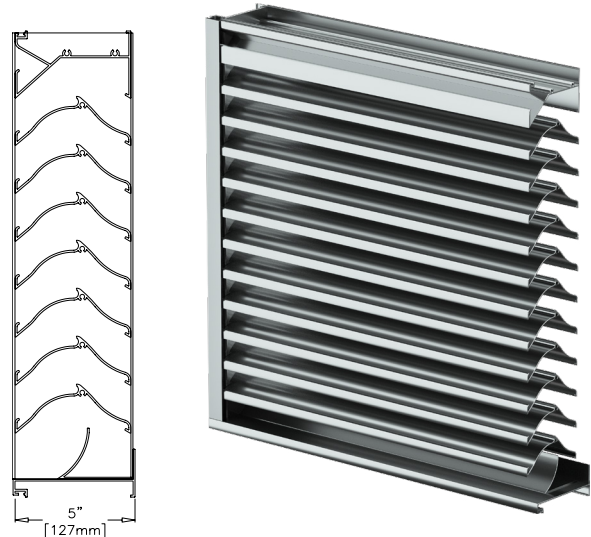

Performance Ratings



Airolite certifies that the K605D louvers shown herein are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to Water Penetration and Air Performance ratings.

Louvers were tested in accordance with AMCA Standard 500-L.

Performance of 48 in. x 48 in. (1219 mm x 1219 mm) Louver

Free Area

Area 9.11 sq. ft. (0.846 sq. m)

Percent 56.9%

Performance at Beginning Point of Water Penetration

Free Area Velocity 1134 fpm (5.761 m/s)

Max Intake Volume 10331 cfm (4.876 m³/s)

Performance at 6,000 CFM (2.832 m³/s) Intake

Pressure Drop 0.151 in. wg (0.038 kPa)

Document Links

[Architectural Louvers Catalog](#)

[Finishes & Colors](#)

[Qwik Ship Guide](#)

[Airolite Warranty Statement](#)

Options and Accessories

- [Bird Screen](#)
- [Blank Off Panels](#)
- [Extended Sill](#)
- [Filter Rack/Filter](#)
- [Flange Frame](#)
- [Glazing Frame](#)
- [Insect Screen](#)
- [Mounting Angles](#)
- [Security Bars](#)
- [Variety of Architectural Finishes](#)
- Welded Construction

Standard Details

K605D Standard Details

Structural reinforcing members may be required to adequately support and install multiple louver sections within a large opening. Structural reinforcing members along with any associated installation hardware is not provided by Airolite unless indicated otherwise by Airolite. Options and accessories including, but not limited to, screens, filter racks, louver doors, and blank off panels are not subject to structural analysis unless indicated otherwise by Airolite.

AIROLITE[®]
The look that works.[™]

K605D

Sightproof Louver | Drainable Blade | Extruded Aluminum

Free Area Chart

Free Area Chart shows free area in square feet and square meters.

Louver Height Inches (Meters)	Louver Width in Inches (Meters)												
	12	24	30	42	48	60	66	78	84	96	102	114	120
0.30	0.30	0.61	0.76	1.07	1.22	1.52	1.68	1.98	2.13	2.44	2.59	2.90	3.05
12	0.32	0.74	0.95	1.37	1.58	1.99	2.15	2.57	2.78	3.19	3.40	3.82	4.03
0.30	0.03	0.07	0.09	0.13	0.15	0.18	0.20	0.24	0.26	0.30	0.32	0.35	0.37
18	0.58	1.33	1.71	2.46	2.83	3.58	3.86	4.62	4.99	5.74	6.12	6.87	7.24
0.46	0.05	0.12	0.16	0.23	0.26	0.33	0.36	0.43	0.46	0.53	0.57	0.64	0.67
24	0.84	1.92	2.46	3.55	4.09	5.17	5.58	6.66	7.20	8.29	8.83	9.91	10.46
0.61	0.08	0.18	0.23	0.33	0.38	0.48	0.52	0.62	0.67	0.77	0.82	0.92	0.97
30	1.09	2.51	3.22	4.64	5.34	6.76	7.29	8.71	9.42	10.84	11.54	12.96	13.67
0.76	0.10	0.23	0.30	0.43	0.50	0.63	0.68	0.81	0.88	1.01	1.07	1.20	1.27
36	1.35	3.10	3.97	5.72	6.60	8.35	9.01	10.76	11.63	13.38	14.26	16.01	16.88
0.91	0.13	0.29	0.37	0.53	0.61	0.78	0.84	1.00	1.08	1.24	1.32	1.49	1.57
42	1.61	3.69	4.73	6.81	7.86	9.94	10.72	12.80	13.85	15.93	16.97	19.05	20.10
1.07	0.15	0.34	0.44	0.63	0.73	0.92	1.00	1.19	1.29	1.48	1.58	1.77	1.87
48	1.86	4.28	5.49	7.90	9.11	11.53	12.43	14.85	16.06	18.48	19.68	22.10	23.31
1.22	0.17	0.40	0.51	0.73	0.85	1.07	1.15	1.38	1.49	1.72	1.83	2.05	2.17
54	2.12	4.87	6.24	8.99	10.37	13.12	14.15	16.90	18.27	21.02	22.40	25.15	26.52
1.37	0.20	0.45	0.58	0.84	0.96	1.22	1.31	1.57	1.70	1.95	2.08	2.34	2.46
60	2.38	5.46	7.00	10.08	11.62	14.71	15.86	18.94	20.49	23.57	25.11	28.19	29.73
1.52	0.22	0.51	0.65	0.94	1.08	1.37	1.47	1.76	1.90	2.19	2.33	2.62	2.76
66	2.63	6.05	7.76	11.17	12.88	16.30	17.58	20.99	22.70	26.12	27.82	31.24	32.95
1.68	0.24	0.56	0.72	1.04	1.20	1.51	1.63	1.95	2.11	2.43	2.58	2.90	3.06
72	2.89	6.64	8.51	12.26	14.14	17.88	19.29	23.04	24.91	28.66	30.54	34.29	36.16
1.83	0.27	0.62	0.79	1.14	1.31	1.66	1.79	2.14	2.31	2.66	2.84	3.19	3.36
78	3.15	7.23	9.27	13.35	15.39	19.47	21.00	25.09	27.13	31.21	33.25	37.33	39.37
1.98	0.29	0.67	0.86	1.24	1.43	1.81	1.95	2.33	2.52	2.90	3.09	3.47	3.66
84	3.40	7.82	10.03	14.44	16.65	21.06	22.72	27.13	29.34	33.76	35.96	40.38	42.59
2.13	0.32	0.73	0.93	1.34	1.55	1.96	2.11	2.52	2.73	3.14	3.34	3.75	3.96
90	3.66	8.41	10.78	15.53	17.90	22.65	24.43	29.18	31.55				
2.29	0.34	0.78	1.00	1.44	1.66	2.10	2.27	2.71	2.93				
96	3.92	9.00	11.54	16.62	19.16	24.24	26.15	31.23	33.77				
2.44	0.36	0.84	1.07	1.54	1.78	2.25	2.43	2.90	3.14				
102	4.17	9.59	12.29	17.71	20.42	25.83	27.86	33.27	35.98				
2.59	0.39	0.89	1.14	1.65	1.90	2.40	2.59	3.09	3.34				
108	4.43	10.18	13.05	18.80	21.67	27.42	29.57	35.32	38.20				
2.74	0.41	0.95	1.21	1.75	2.01	2.55	2.75	3.28	3.55				
114	4.69	10.77	13.81	19.89	22.93	29.01	31.29	37.37	40.41				
2.90	0.44	1.00	1.28	1.85	2.13	2.70	2.91	3.47	3.75				
120	4.94	11.36	14.56	20.98	24.18	30.60	33.00	39.42	42.62				
3.05	0.46	1.06	1.35	1.95	2.25	2.84	3.07	3.66	3.96				




K605D

Sightproof Louver | Drainable Blade | Extruded Aluminum

Airflow Resistance

Standard Air - 0.075 lb/ft³ (1.2 kg/m)

Test size 48 in. x 48 in. (1219 mm x 1219 mm)

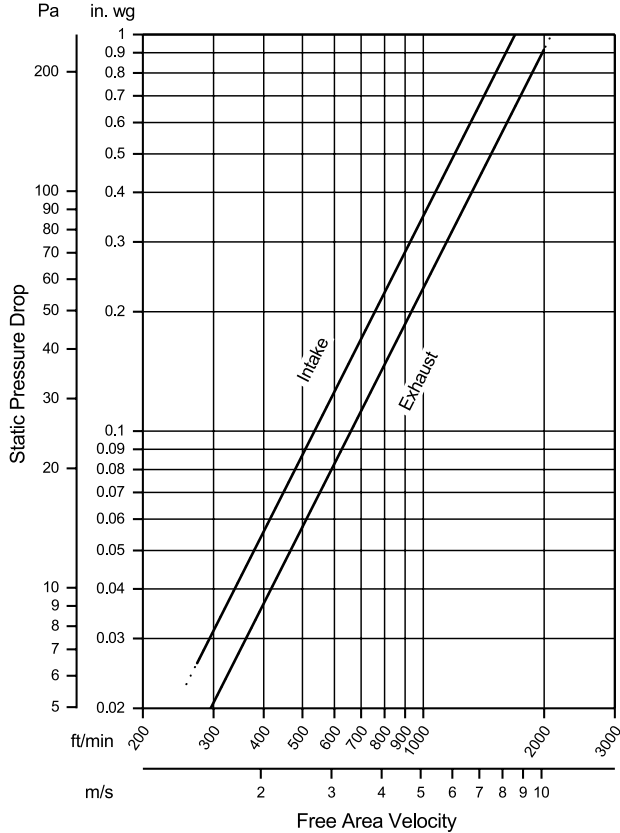


Water Penetration

Standard Air - 0.075 lb/ft³ (1.2 kg/m)

Test size 48 in. x 48 in. (1219 mm x 1219 mm)

Test duration of 15 min.

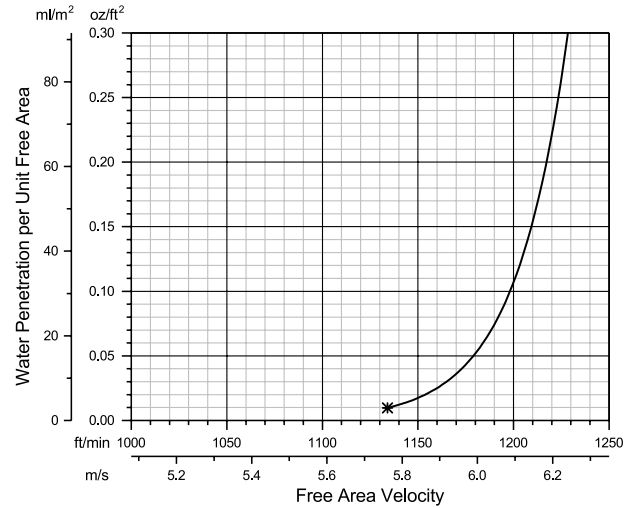

The AMCA Water Penetration Test provides a method for comparing various louver models and designs as to their efficiency in resisting the penetration of rainfall under specific laboratory test conditions. The beginning point of water penetration is defined as that velocity where the water penetration curve projects through 0.01 oz. (3 g) of water (penetration) per sq. ft. (m²) of louver free area. ***The beginning point of water penetration for Model K605D is 1134 fpm (5.7661 m/s) free area velocity.** These performance ratings do not guarantee a louver to be weatherproof or stormproof and should be used in combination with other factors including good engineering judgement in selecting louvers.

