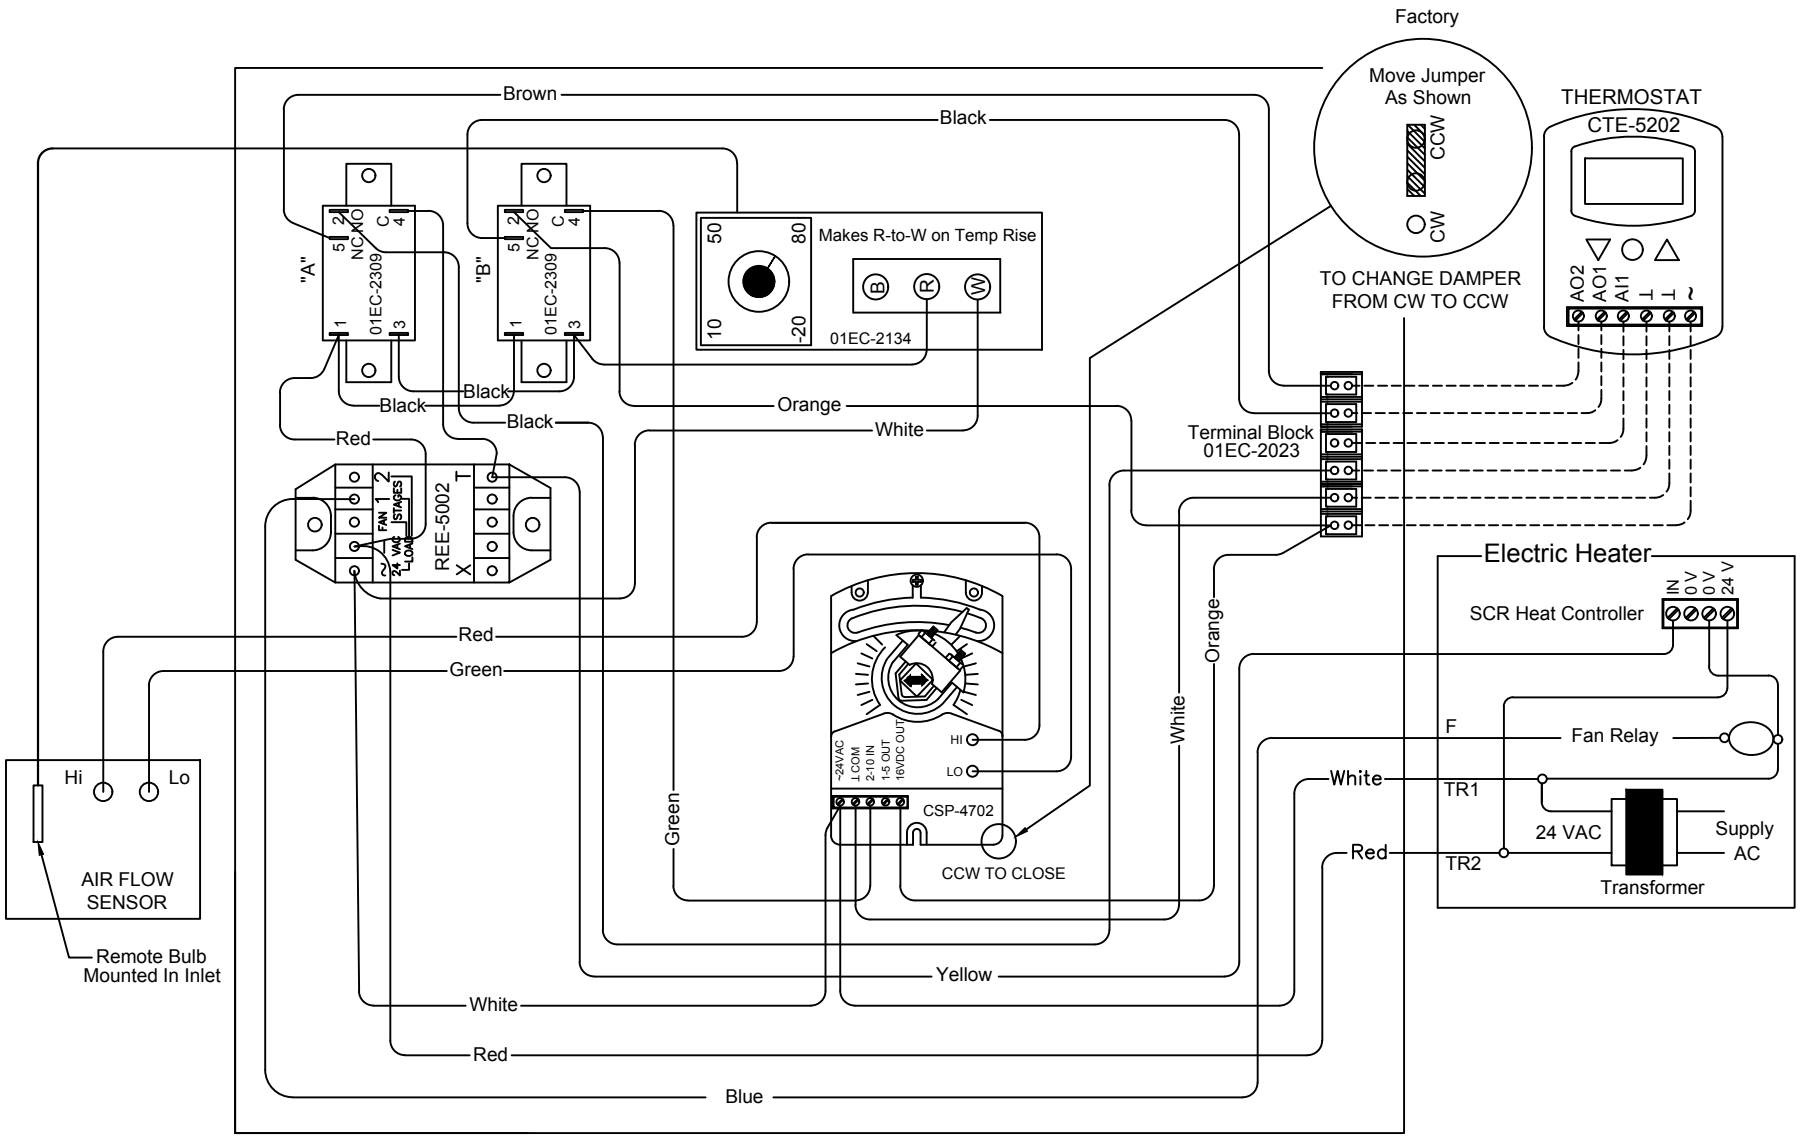

——— Factory Piping
– – – Field Piping By Others

Controller/Actuator-CSP-4702, 24 VAC, 4 VA
Thermostat-CTE-5202
Reheat Module-REE-5002, 24 VAC
Relays SPDT - HCR-51CQ1AC112 or Equiv.
Note : Do not interconnect 24V transformer secondary circuits.

FVCD864-MW-SCR

(CDS) ATU\CONTROL DIAGRAMS\ANALOG\

Phone: 715.359.6171
Fax: 715.355.2399
Parts : 800.355.5354
gfcinfo@greenheck.com
www.greenheck.com

ECN. No.	Rev	Description	Date	Rev'd By:
N/A	D	Removed logo	7/14/21	CG
N/A	C	UPDATED TO NEW FORMAT	06/20/17	RML
N/A	B	Rev. Stat & Controller	2/16	DSG
N/A	A	Revised SCR Wiring	3/5/13	DSG

Unless Otherwise Specified:
1. Dimensions Are In Inches.
2. Tolerances Are:

Fractions	Decimals	Angles
±1/32	±.X = .1 ±.XX = .02 ±.XXX = .010	±1°

Control Wiring Diagram

AUTO MORNING WARM–UP
FAN AND SCR CONTROLLED HEAT

DWN. BY DSG	DATE 01/03/07	DWG. NO. FVCD864–MW–SCR	REV. D
CHK'D BY DSG	SCALE NTS		