




Building Value in Air.

AIR FLOW  
SENSOR




To N.C. Fan P.E.  
Set to 6 PSI


To N.C. Heat P.E.  
Set to 7 PSI  
Optional Heat

Green

Red

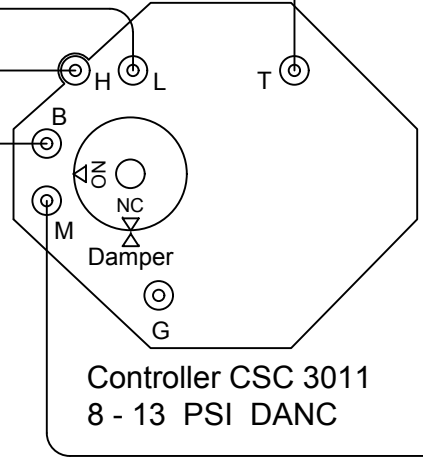


Controller CSC 3011  
8 - 13 PSI DANC

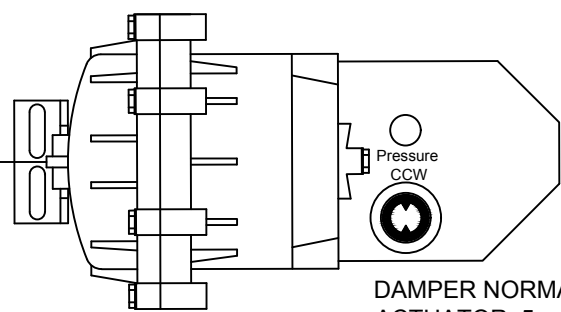

DAMPER NORMALLY CLOSED  
ACTUATOR 5 - 10 PSI  
MCP 3631-3000

Direct Acting

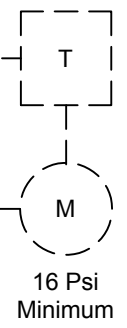

———— Factory Piping

- - - - Field Piping By Others

FCCD 914M

(CDS) ATU\CONTROL DIAGRAMS\PNEUMATIC\

# Control Wiring Diagram

Unless Otherwise Specified:  
1. Dimensions Are In Inches.  
2. Tolerances Are:  
Fractions Decimals Angles  
 $\pm 1/32$   $\pm .X = .1$   $\pm 1^\circ$   
 $\pm .XX = .02$   
 $\pm .XXX = .010$

DANC 8 - 13 PSI PNEUMATIC  
PRESSURE INDEPENDENT

Phone: 715.359.6171  
Fax: 715.355.2399  
Parts : 800.355.5354  
gfcinfo@greenheck.com  
www.greenheck.com

N/A	D	Removed logo	7/12/21	CG
N/A	C	UPDATED TO NEW FORMAT	07/14/17	RML
N/A	B	Update	9/18/04	JEFF S.
ECN. No.	Rev	Description	Date	Rev'd By:

DWN. BY	DG	DATE	11/05/99	DWG. NO.		REV.	
CHK'D BY	RE	SCALE	NTS	FCCD914M		D	